



SERVICE PROVIDER

Rivera Backflow & Plumbing
Austin, TX
(555) 010-0142

CUSTOMER

Eastside Taqueria
Attn: Jane Roe
2401 E 6th St, Austin, TX 78702

DATE

Oct 7, 2026

TIME ON SITE

08:40 – 10:15

TECHNICIAN

John Doe

REASON FOR TEST

Annual

WATER PURVEYOR

City Water Utility

WATER ACCOUNT / METER #

0041-18273

METER READING

0418 223

UTILITY DEVICE / HAZARD #

HZ-40871

TYPE OF SERVICE

Domestic

MAKE & MODEL

Watts 909

ASSEMBLY TYPE

RP

SERIAL NUMBER

7731-A

SIZE

2"

LOCATION OF ASSEMBLY

Mechanical room, north wall

LINE PRESSURE

68 psi

LINE PRESSURE STABLE

Yes

SHUT-OFF VALVE #1

Closed tight

SHUT-OFF VALVE #2

Closed tight

INITIAL TEST

CHECK VALVE #1

6.4 psid

RELIEF VALVE OPENED AT

3.2 psid

CHECK VALVE #2

2.1 psid

CHECK VALVE #1

Closed tight

CHECK VALVE #2

Closed tight

INITIAL TEST RESULT

Passed

TESTER AND TEST KIT

TESTER CERTIFICATION #

TX BPAT-0098812

CERTIFICATION EXPIRES

Aug 3, 2027

TEST KIT

Watts TK-DP

TEST KIT SERIAL

22-5517

TEST KIT CALIBRATION DATE

Jun 9, 2026

RESULTS FILED WITH THE UTILITY ON


Oct 7, 2026

PHOTOS



Assembly and test kit

08:52

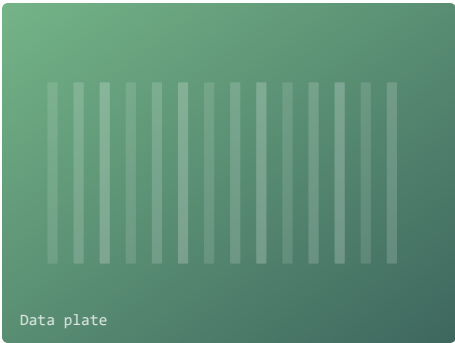

Data plate

09:21

CERTIFICATION

I certify that the assembly above was tested in accordance with AWWA / USC field test procedures and that the information in this report is true and correct.

TECHNICIAN



John Doe · 10:22 AM
TCEQ Backflow Tester BPAT-0098812



CUSTOMER



Jane Roe · 10:24 AM